

DTI - 200x200 Uni Ivory Matt R10A Batch - 758744 BP42 - Wet Sliptest KO010720-3

01 Jul 2020

Slip Resistance Classification of New Pedestrian Surfaces - AS4586:2013 Appendix A

Date Tested: 01 Jul 2020

Test Report Number: KO010720-3

Client Name & Address: DTI - 485 Zillmere Road ZILLMERE QLD 4034

Test Site / Surface Tested : 200x200 Uni Ivory Matt R10A Batch - 758744 BP42

Sample Information : Samples and Test Information Supplied by Client

Wet Pendulum Test carried out using : Slider 96 (4S) Rubber slider

Record ambient temperature (°C) 24

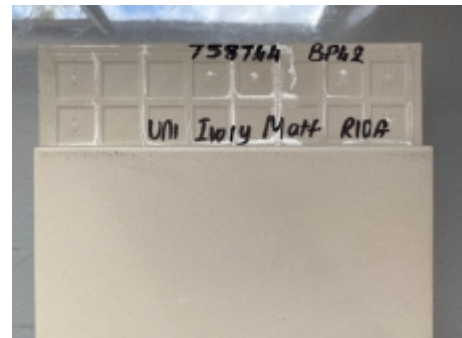
Testing Officer : Kathryn Ording

Testing Officer : #SK2072 - 07.05.19 - Wessex Portable Skid Tester

Testing Officer Signatory:



Test Results :

Sample No.	Swing 1	Swing 2	Swing 3	Swing 4	Swing 5	Mean BPN of last 3 swings :	Surface Picture
T1	41	41	40	40	40	40	
T2	35	33	33	33	33	33	
T3	40	40	40	40	40	40	
T4	36	36	36	36	36	36	
T5	38	38	38	38	38	38	

Mean BPN Slip Resistance Value (SRV)

37

CLASSIFICATION using Slider 96 (4S Slider)

P3 = 35 - 44

Accredited for Compliance with ISO/IEC 17025. The information presented herein and on the Sliptest Report is copyright and is protected by copyright law, any reproduction of this information and test report except in full is prohibited. Sliptest Australia Pty. Ltd. performed this on site test with reference to the following Australian Standard testing criteria, of AS 4586:2013 Classification of new pedestrian surface materials. Appendix A - Wet Pendulum Test Method and Hand Book HB 198: 2014 with reference to AS/NZS 4663: 2004 Slip Resistance measurement of existing pedestrian surfaces and HB 197: 1999. These results do not account for Future Wear, Maintenance or Contamination of this surface once in-situ.

